

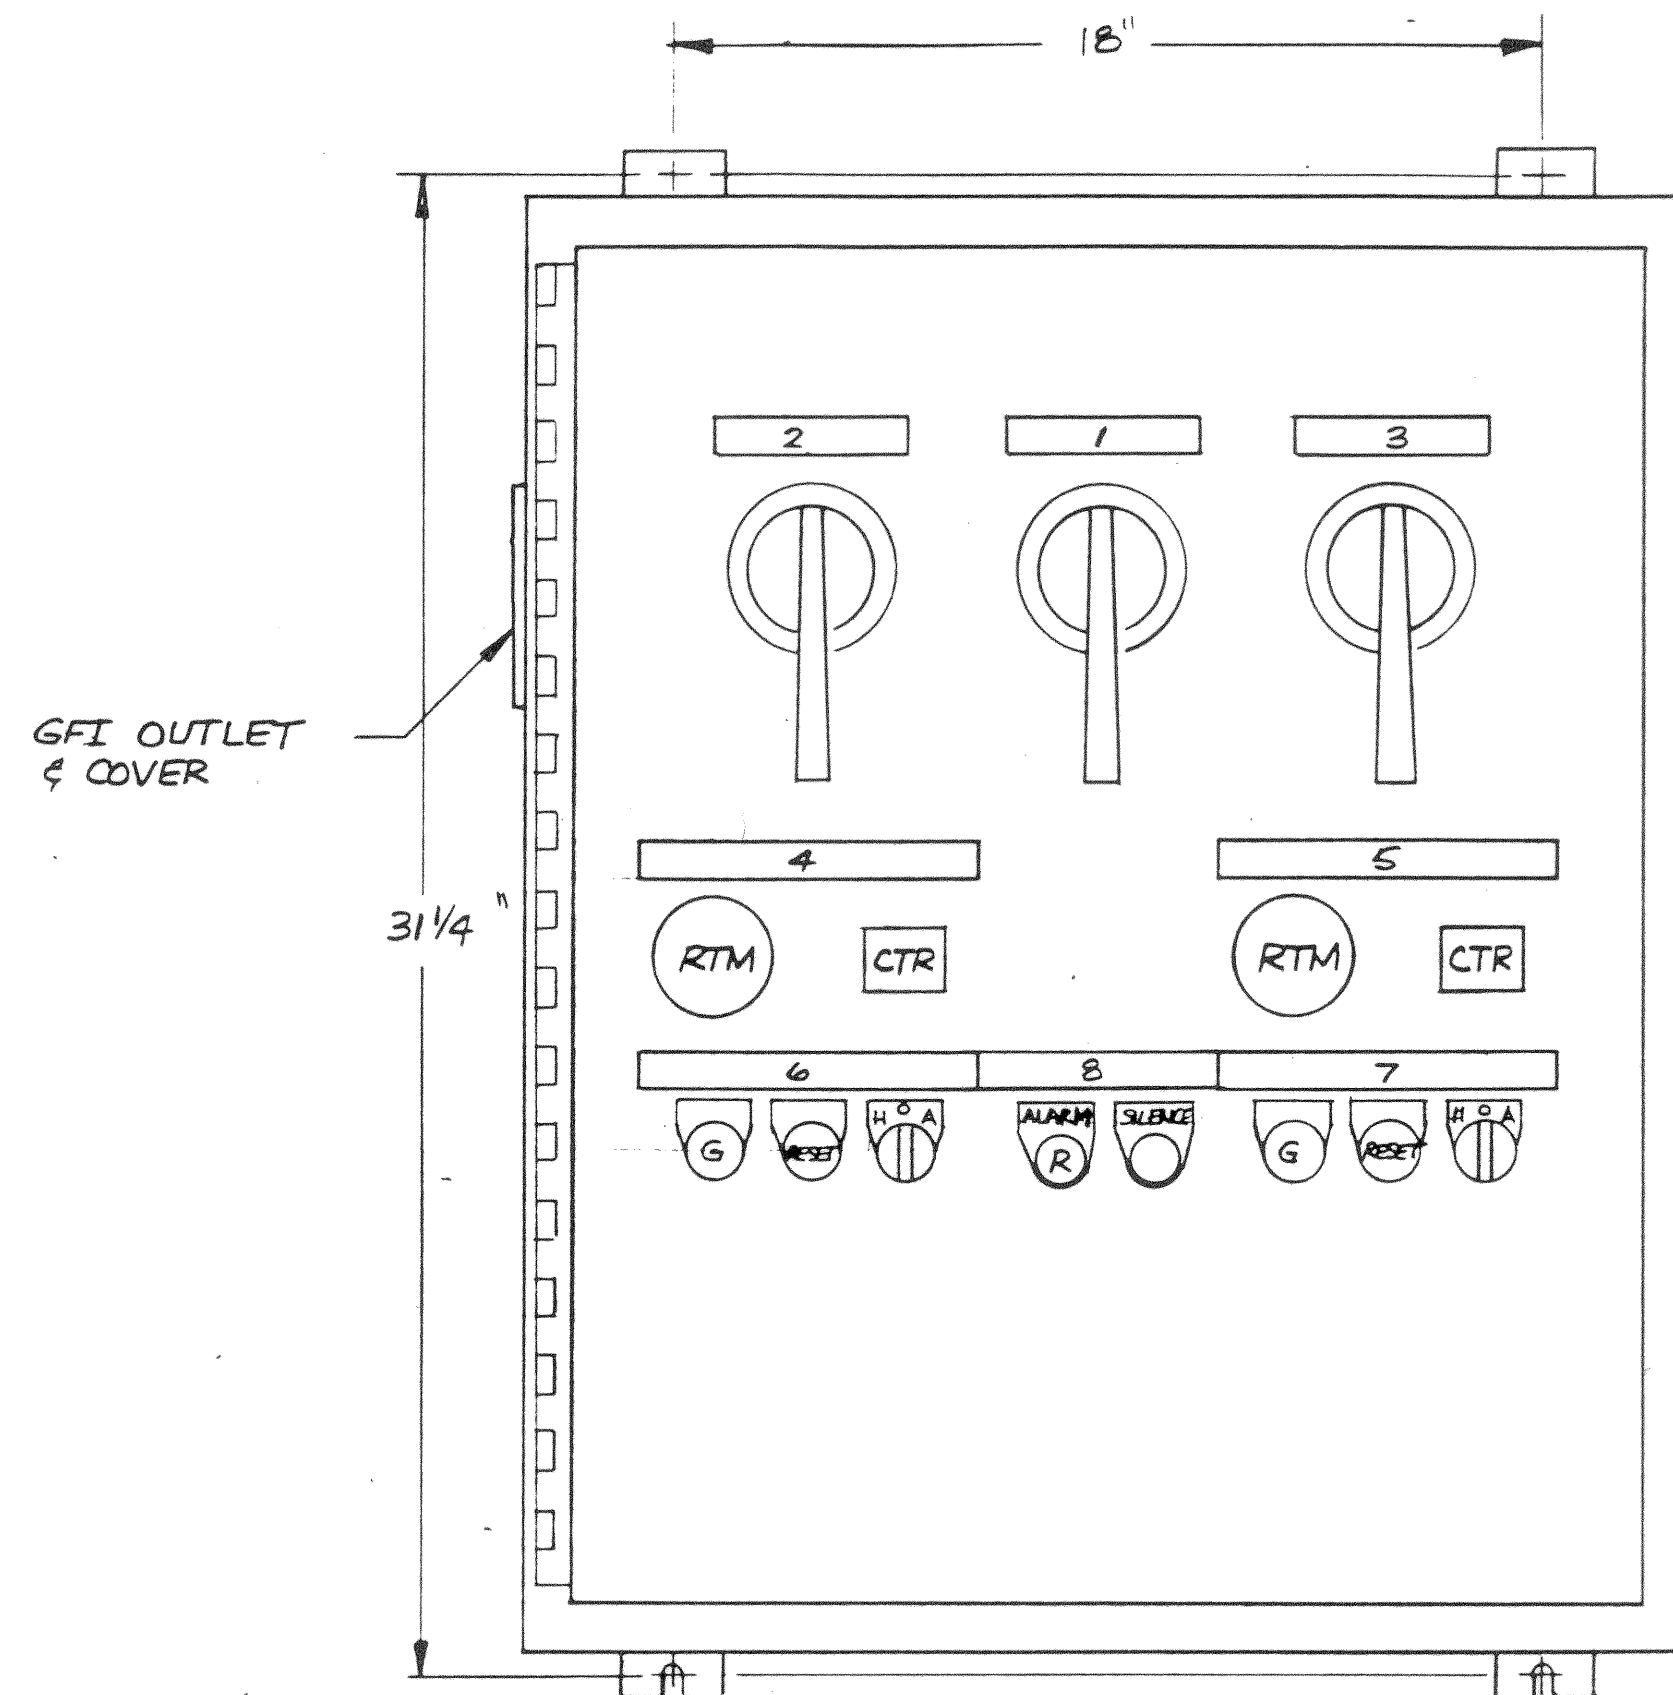
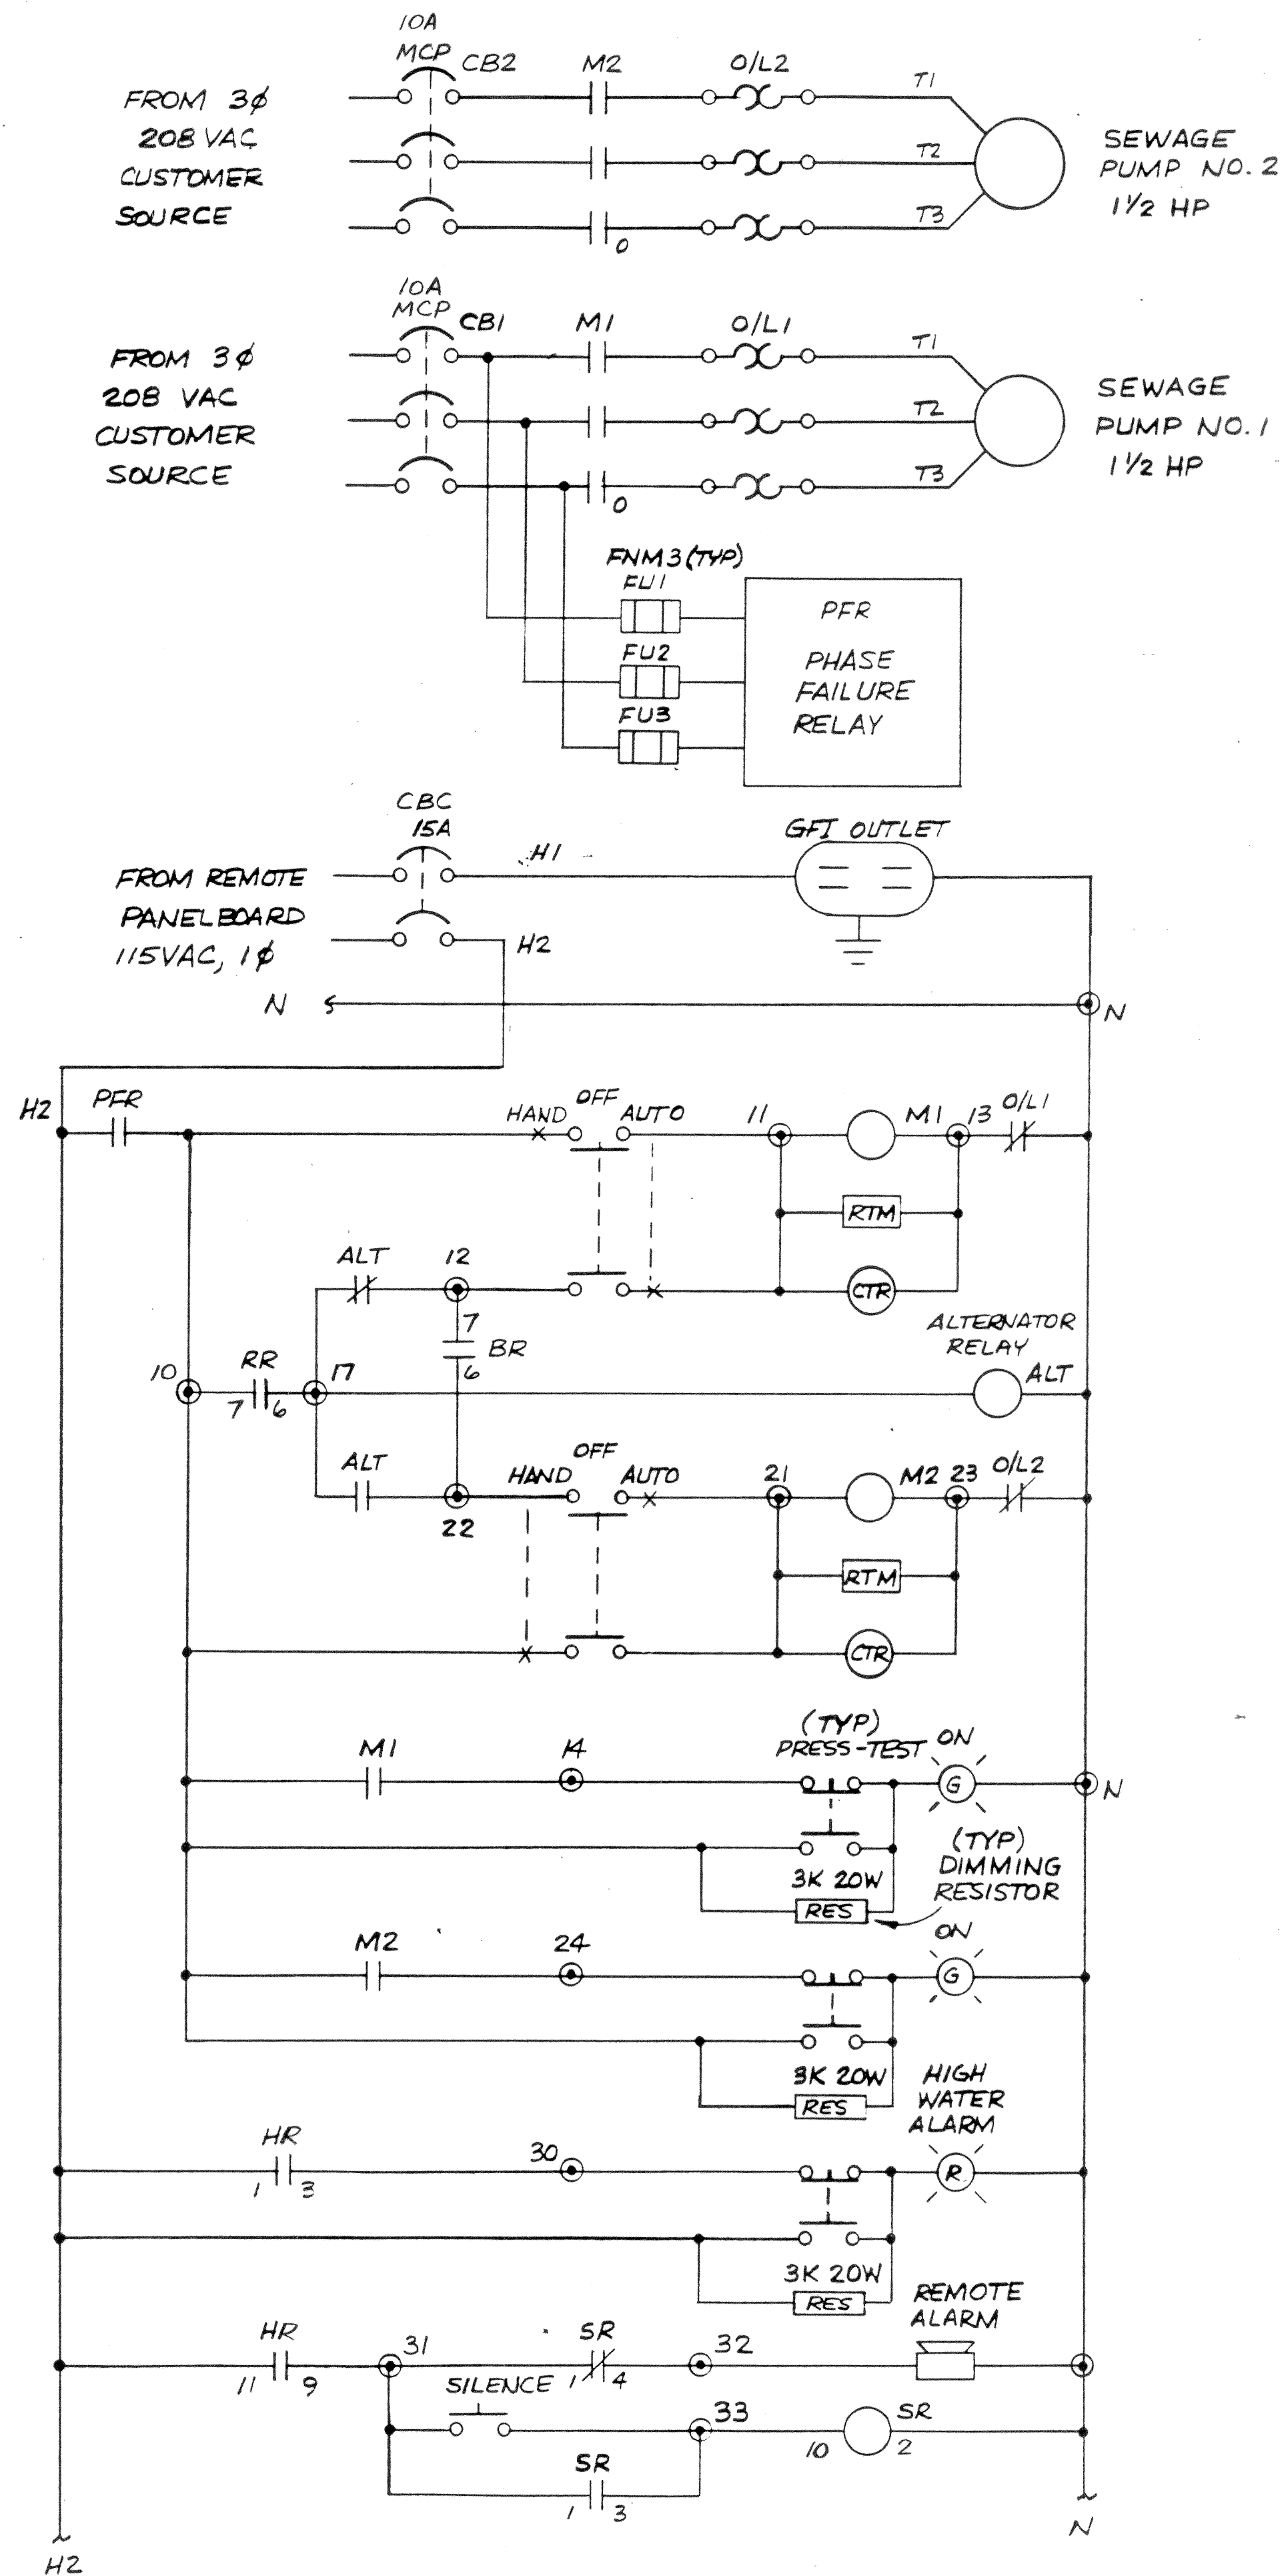


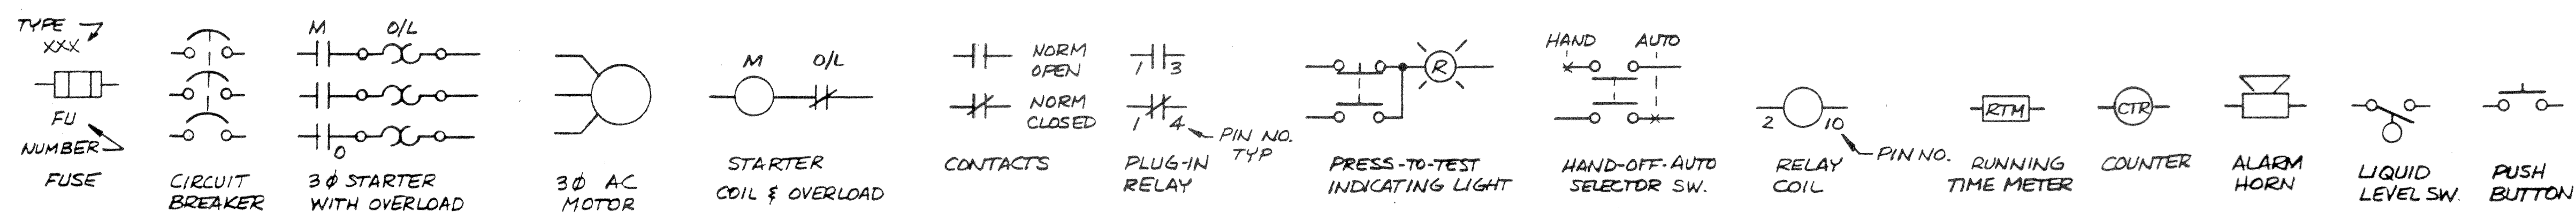


FRONT VIEW

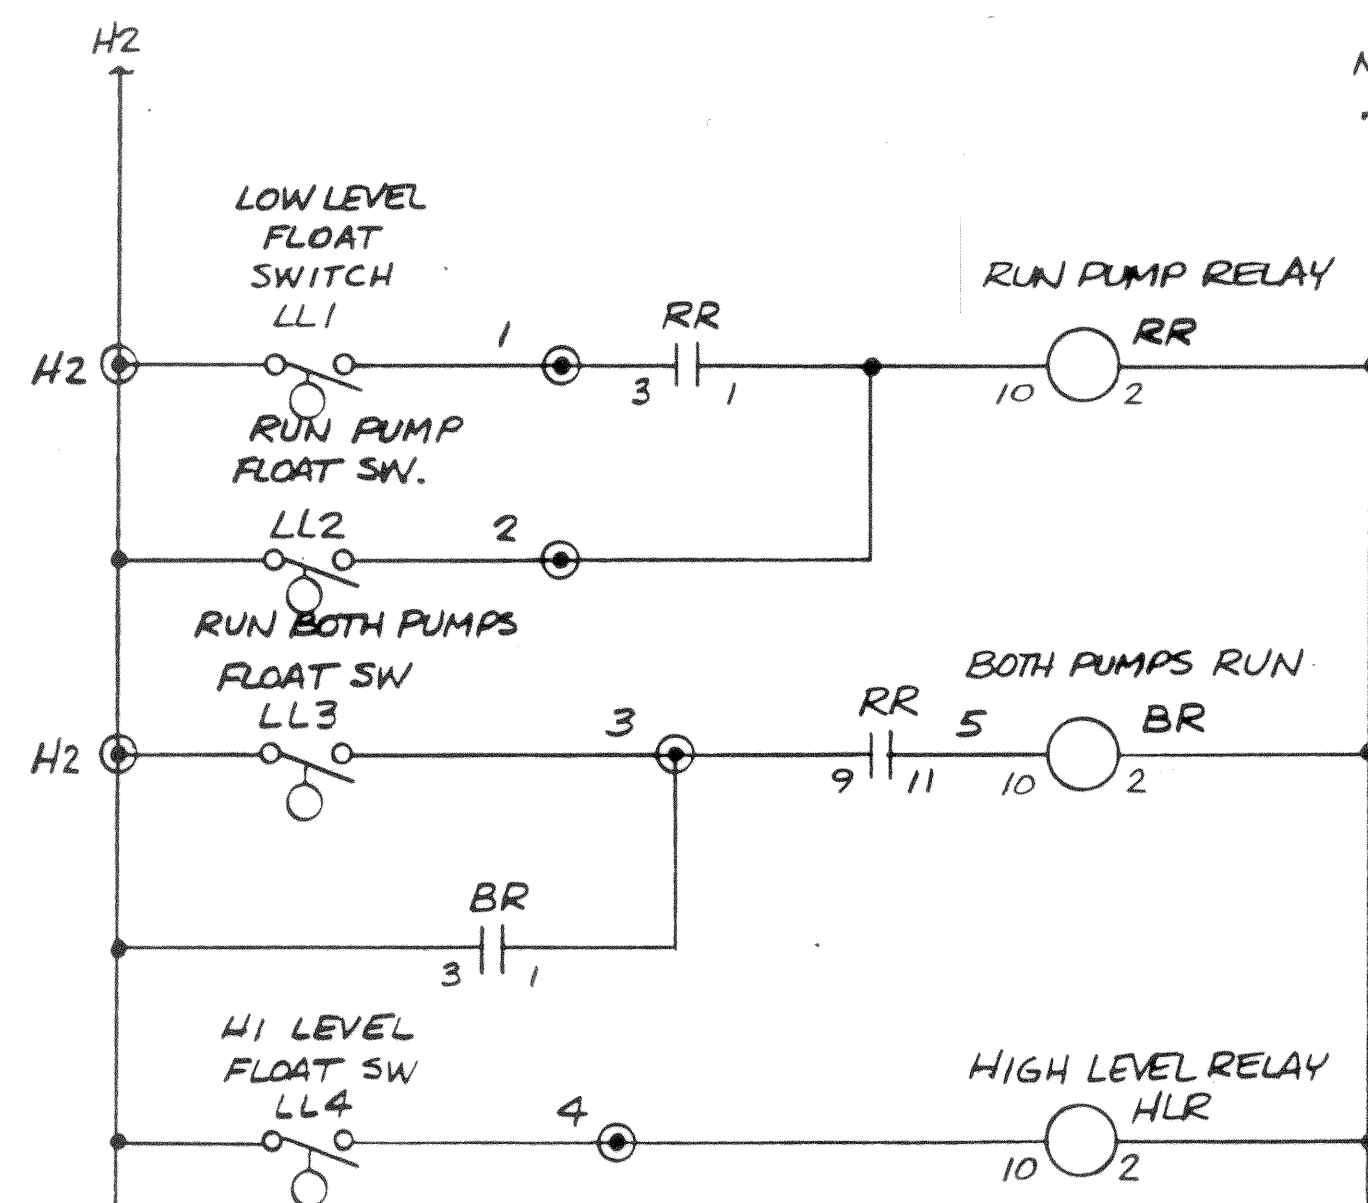


NOTE:

ALL WIRE TO BE #14 MTW - UL LISTED

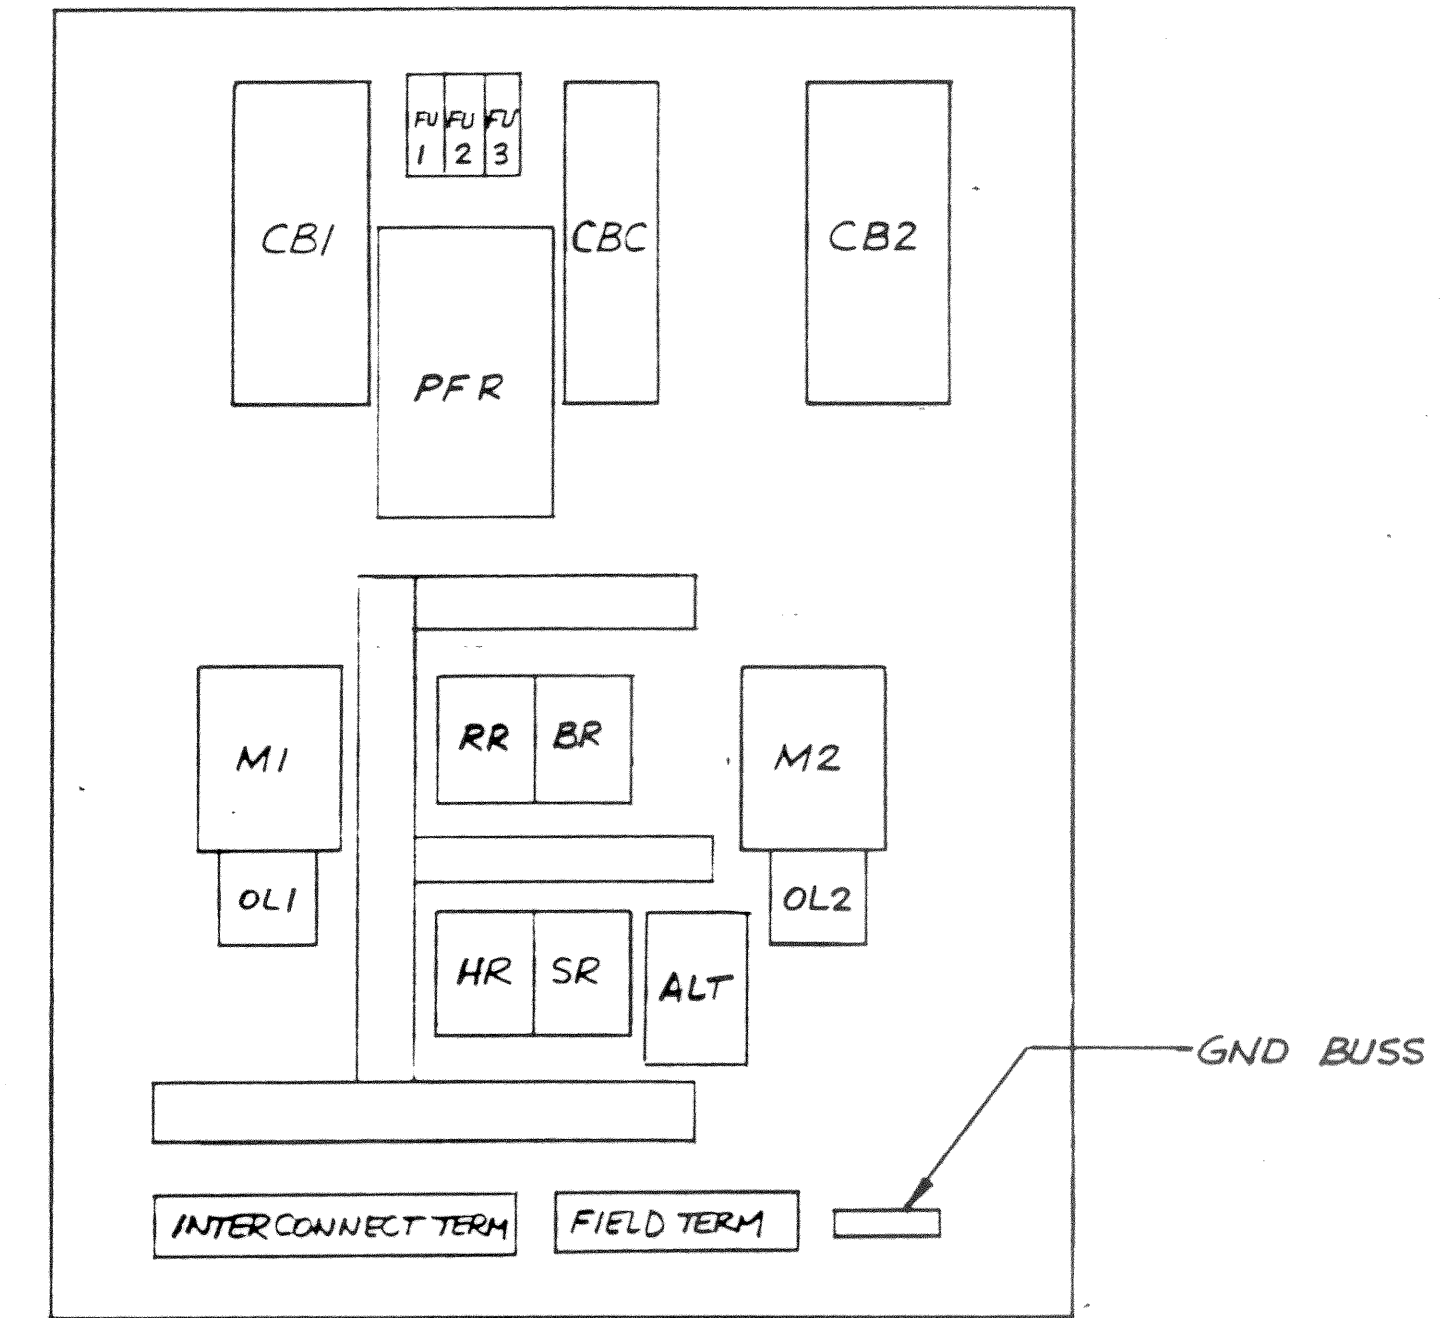

INTERIOR PANEL

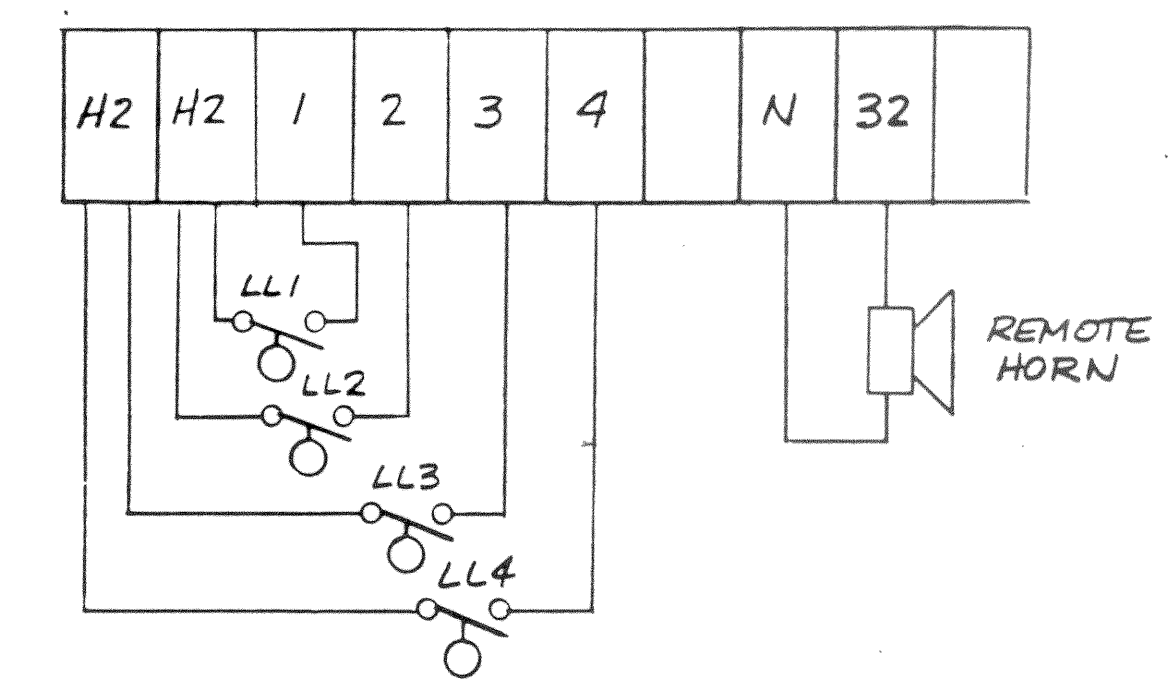

FIELD TERMINAL CONNECTIONS

NAMEPLATE SCHEDULE		
NO	SIZE	DESCRIPTION
1	1x4	CONTROL CIRCUIT DISCONNECT
2	1x4	PUMP NO. 1 POWER
3	1x4	PUMP NO. 2 POWER
4	1x7	PUMP NO. 1 RUNNING TIME START COUNTS
5	1x7	PUMP NO. 2 RUNNING TIME START COUNTS
6	1x7	PUMP NO. 1 RUNNING O/L RESET CONTROL SW
7	1x7	PUMP NO. 2 RUNNING O/L RESET CONTROL SW
8	1x7	HIGH SEWAGE LEVEL

208 V-3 ϕ , 1 1/2 HP

DO NOT SCALE
ALL DIMENSIONS ARE
IN INCHES
ALL ANGLES & BENDS 90°
BREAK ALL SHARP EDGES

TOL UNLESS OTHERWISE NOTED

XX ± .010

XXX ± .005

DWN RUSS 10-15-85

CHK RR/RH 12-13-85

ENG

APPROV.

FOR: PHS-ALASKA AREA NATIVE HEALTH SERVICE ST. PAUL, ALASKA

TITLE SCHEMATIC - LAYOUT

DUPLEX - SEWAGE PUMP CONTROL

DWG NO. 510-184

REV B

SCALE 1" = 4"

SHEET / OF /

Electrical Packaging Co. Inc.
13010 Hiway 99 South
Everett, Washington 98204